



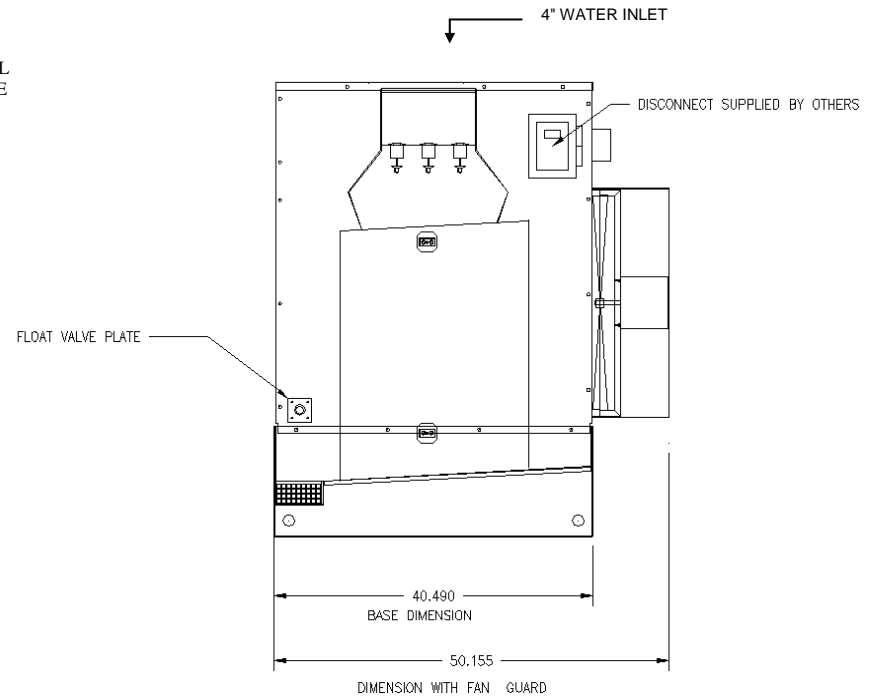

**Notes**

1. MATERIAL: SPRAY NOZZLE ASSEMBLY, MEDIA CHANNEL & DRAIN SCREEN: 16GA 304 STAINLESS STEEL
2. MATERIAL: CABINET 16GA GALVANEAELED STEEL OR 304 STAINLESS STEEL UNLESS NOTED OTHERWISE
3. MATERIAL: BASE: 12GA GALVANEAELED STEEL OR 304 STAINLESS STEEL UNLESS NOTED OTHERWISE
4. FINISH: POLANE COATING OR STAINLESS STEEL 2B MILL FINISH
5. ALL GALVANEAELED STEEL TO BE ASTM A653 A40 AND/OR A60

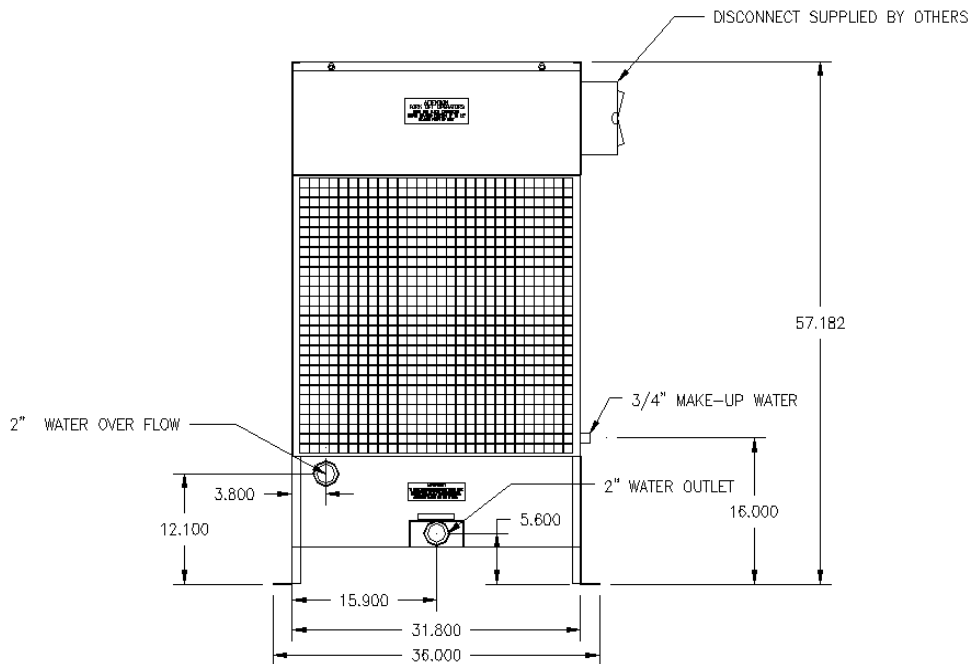

Electrical: 208-230/1  
 Fans: [1] 24"  
 Motors: AO Smith F48866AO1 [1] 1/2 hp  
 Full Load Amps: 2.7 to 3.7

**THIS DRAWING IS THE PROPERTY OF POLAR AIR SYSTEMS, LLC  
 ANY USE WITHOUT WRITTEN PERMISSION IS PROHIBITED**

**© Polar Air Systems, LLC, 2008**

<b>Polar Air Systems, LLC</b>		
	Do Not Scale	Revision
Date: July 1, 2008	Drawing	1
<b>TITLE</b>	PC-005 Detail	Drawing No: PC-A-005-708
Product: POLAR CASCADE COOLING TOWER		